

# TYPICAL INSTALLATION INSTRUCTIONS

## HIGH TOWER BRACKET-AUTOMATIC IGNITION

Applies to all High Tower Mounted lanterns  
Sizes : Small, Medium, Large & Grande


Light Supplied w/  
1-Mounting Bar  
1-Brass IP Cap  
1-2"x 1/8" IP All Thread Nipple

Natural Gas Requires 7" W.C. BTU 2730  
Propane Gas Requires 11" W.C. BTU 2080

Attach the Mounting Bar that's provided to the junction box with screws. Screw All Thread Nipple into the Mounting Bar, leaving enough of the nipple to penetrate through the hole in the bracket. Connect the gas line from the lantern to the main. Make sure to test the fittings for gas leaks before securing the lantern to the wall. Connect wires to power source, Smooth(+) to Black & Ribbed(-) to White. Position light over the all thread nipple and attach cap, tightening to securely mount light.

Clearance:


-12" from vent  
to ceiling  
-6" from sides

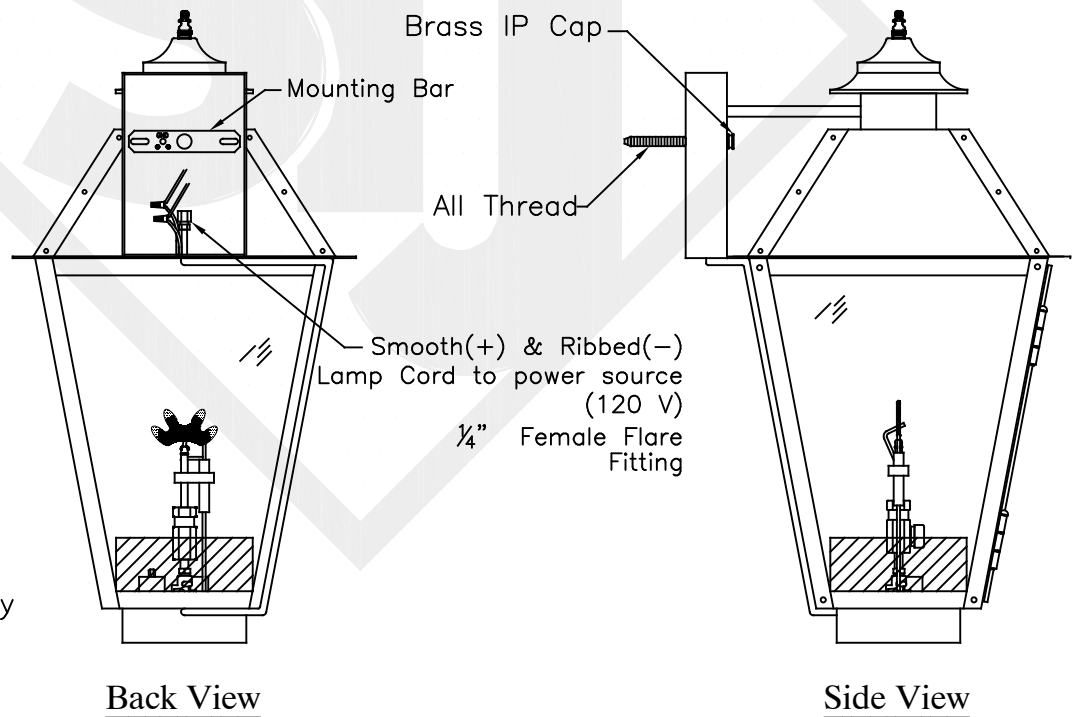

Apply Caulking to  
both sides and top of  
Wall Box. DO NOT apply  
on bottom

CAUTION: Risk of fire or electric shock

This product is to be installed by a qualified Plumber ONLY.  
Installation must conform with all local codes or, in the absence of  
local codes, to UL 1598, Gas Code ANSI Z21.42 - 2004, Gas  
Illuminating Appliance

|   |                 |
|---|-----------------|
| Typical Install<br>High Tower Bracket   |                 |
|  St. James<br>LIGHTING |                 |
| SCALE: N.T.S.   | DRAFT: B. Vial  |
| FILE: INSTALL   | APP'D: J. Ragan |
| JOB: X  | DATE: 03/15/18  |